

Test Report

Number: GZHH00357620

Applicant: DINO DECKING LTD.
UNIT 1 WETHERAL CLOSE HINDLEY INDUSTRIAL
ESTATE HINDLEY GREEN WIGAN WN2 4HS, UK

Date: Apr 13, 2020


Sample Description:
One (1) submitted sample said to be **Classic Composite Decking**

Date Sample Received : Mar 30, 2020
Testing Period : Mar 30, 2020 to Apr 13, 2020

Tests conducted:
As requested by the applicant, refer to attached page(s) for details.

<u>Tested sample</u>	<u>Test item</u>	<u>Result</u>
Submitted samples	Slip Resistance - Pendulum Test - As per CEN/TS 15676: 2007	See test conducted
	Fire Classification Test on Classic Composite Decking - As per EN 13501-1: 2018	See test conducted

Authorized by:
For Intertek Testing Services Shenzhen Ltd.
Guangzhou Branch, Hardlines


Victor T.J. Wang
Assistant General Manager



D I N O D E C K I N G



Test Report

Number: GZHH00357620

Tests Conducted

1 Slip Resistance - Pendulum Test

As per CEN/TS 15676: 2007, the tested samples were subjected to the following tests.

Sample description: Classic Composite Decking

Initial inspection: No any damage was found.

Executive summary:

Test item	Test parameter	Test result	
Slip Resistance - Pendulum Test	Test method: As per CEN/TS 15676:2007 Specimen: 250 × 91.3 mm Slider type: Four-S rubber Sliding length: 126mm (C scale) Testing Condition: Wet surface	Front side-X direction	56
		Front side-Y direction	38
		Back side-X direction	67
		Back side-Y direction	52



Tests Conducted

2 Fire Classification Test on Classic Composite Decking

As per EN 13501-1:2018, the tested samples were subjected to the following tests.

Sample description: Classic Composite Decking

Initial inspection: No any damage was found

Executive summary:

No.	Test item			Test method	Standard's requirement	Test result	Conclusion	
1	Critical heat flux			EN ISO 9239-1: 2010	$\geq 4.5\text{kW/m}^2$	4.7kW/m ²	Pass	
2	Flammability	Surface flame attack (Exposure = 15 s)	Flame spread within 20s	EN ISO 11925-2:2010+AC: 2011	$\leq 150\text{mm}$	28mm	Pass	
3	Smoke production			EN ISO 9239-1:2010	s1 s2	$\leq 750\% \times \text{min}$ Not s1	119.3 % min	Class: s1
Conclusion	EN 13501-1:2007+A1:2009 Fire classification of construction products and building elements - Part 1: Classification using data from reaction to fire tests : C_{fl} - s1							
Remark	The test results relate to the behavior of the test specimens of a product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.							

D E C K I N G



Tests Conducted

Annex A

Classes of reaction to fire performance for floorings

Class	Test method(s)	Classification criteria	Additional classification
A1 _{fl}	EN ISO 1182 ^a and	$\Delta T \leq 30 \text{ }^\circ\text{C}$; and $\Delta m \leq 50 \%$; and $t_f = 0$ (i.e. no sustained flaming)	-
	EN ISO 1716	$PCS \leq 2,0 \text{ MJ/kg}^a$ and $PCS \leq 2,0 \text{ MJ/kg}^b$ and $PCS \leq 1,4 \text{ MJ/m}^2^c$ and $PCS \leq 2,0 \text{ MJ/kg}^d$	-
A2 _{fl}	EN ISO 1182 ^a or	$\Delta T \leq 50 \text{ }^\circ\text{C}$ and $\Delta m \leq 50 \%$ and $t_f \leq 20 \text{ s}$	-
	EN ISO 1716 and	$PCS \leq 3,0 \text{ MJ/kg}^a$ and $PCS \leq 4,0 \text{ MJ/m}^2^b$ and $PCS \leq 4,0 \text{ MJ/m}^2^c$ and $PCS \leq 3,0 \text{ MJ/kg}^d$	-
	EN ISO 9239-1 ^e	Critical flux $^f \geq 8,0 \text{ kW/m}^2$	Smoke production ^g
B _{fl}	EN ISO 9239-1 ^e and	Critical flux $^f \geq 8,0 \text{ kW/m}^2$	Smoke production ^g
	EN ISO 11925-2 ^h : Exposure = 15 s	$F_s \leq 150 \text{ mm}$ within 20 s	-
C _{fl}	EN ISO 9239-1 ^e and	Critical flux $^f \geq 4,5 \text{ kW/m}^2$	Smoke production ^g
	EN ISO 11925-2 ^h : Exposure = 15 s	$F_s \leq 150 \text{ mm}$ within 20 s	

D E C K I N G



Test Report

Number: GZHH00357620

Tests Conducted

Class	Test method(s)	Classification criteria	Additional classification
D _{fl}	EN ISO 9239-1 ^e and	Critical flux ^f ≥ 3,0 kW/m ²	Smoke production ^g
	EN ISO 11925-2 ^h : Exposure = 15 s	F _s ≤ 150 mm within 20 s	
E _{fl}	EN ISO 11925-2 ^h : Exposure = 15 s	F _s ≤ 150 mm within 20 s	
F _{fl}	No performance determined		

^a For homogeneous products and substantial components of non-homogeneous products.

^b For any external non-substantial component of non-homogeneous products.

^c For any internal non-substantial component of non-homogeneous products.

^d For the product as a whole.

^e Test duration = 30 min.

^f Critical flux is defined as the radiant flux at which the flame extinguishes or the radiant flux after a test period of 30 min, whichever is the lower (i.e. the flux corresponding with the furthest extent of spread of flame).

^g s1 = Smoke ≤ 750 % minutes;

s2 = not s1.


^h Under conditions of surface flame attack and, if appropriate to the end use application of the product, edge flame attack

D E C K I N G



Tests Conducted

Photo for reference

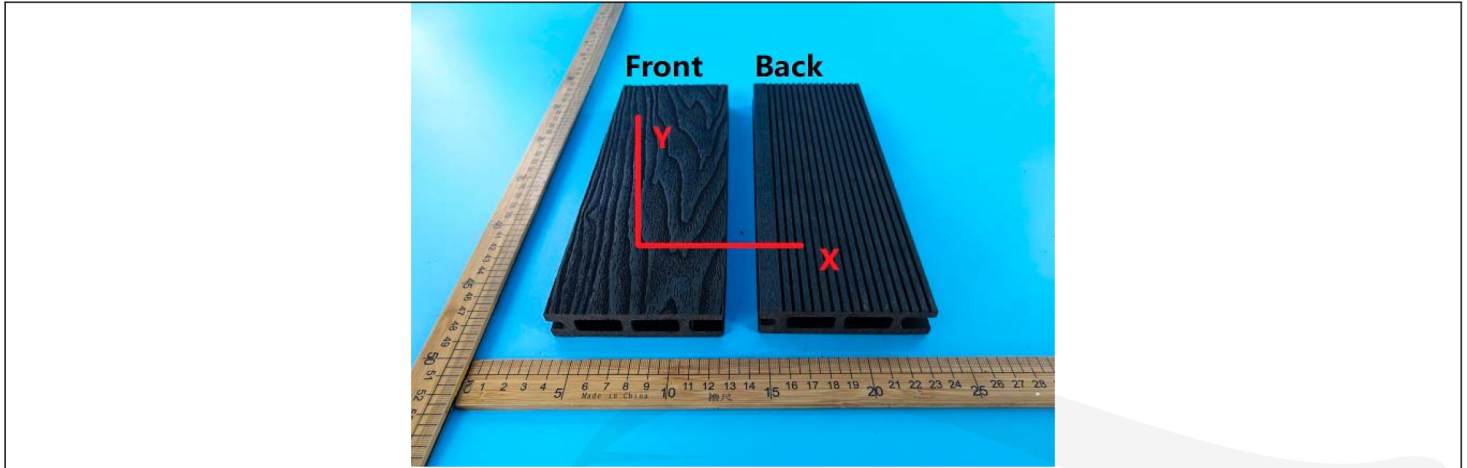

Original sample

End of report

The statements of conformity reported have considered the decision rule agreed, namely that Intertek have taken account of measurement uncertainty as calculated by Intertek, and applied according to ILAC-G8/09:2019 (Non-binary acceptance based on guard band $w = U$) except designation from the customer, regulation or test specification.

This report is made solely on the basis of your instructions and/or information and materials supplied by you. It is not intended to be a recommendation for any particular course of action. Intertek does not accept a duty of care or any other responsibility to any person other than the Client in respect of this report and only accepts liability to the Client insofar as is expressly contained in the terms and conditions governing Intertek's provision of services to you. Intertek makes no warranties or representations either express or implied with respect to this report save as provided for in those terms and conditions. We have aimed to conduct the Review on a diligent and careful basis and we do not accept any liability to you for any loss arising out of or in connection with this report, in contract, tort, by statute or otherwise, except in the event of our gross negligence or wilful misconduct. This report shall not be reproduced unless with prior written approval from Intertek Testing Services Shenzhen Limited, Guangzhou Branch.

DECLINING

